



Sensing Solutions since 1959

Installation and Maintenance

M3784 Conductivity Sensor Head

Sensor Head

- 1 inch NPT (Standard) Conductivity Probes
- Probes can be cut to length. Remove probes from sensor head by carefully unthreading them from inserts. Do not over tighten when reinstalling.
- Cut two (2) probes to the same length, these will be the common and lower level probes. See figure 1.
- Cut one (1) probe to the desired length for the upper level of the tank. See figure 1.
- Spacer should be located approximately 1 inch from bottom of shortest probe.
- If build-up occurs on probes, a short circuit could occur. If this happens apply shrink tubing to the probes leaving the last 1/2 inch bare.

Wiring

- Install cable into sensor head through the compression fitting supplied.
- Attach one lead between the common probe terminal and pin five (5) on the controller.
- Attach a second lead between the lower level probe terminal and pin six (6) on the controller.
- Attach a third lead between the upper level probe terminal and pin eight (8) on the controller.
- Tighten compression fitting until cable can not be pushed into sensor head.

Ratings

- Maximum pressure: 30 PSIG
- Maximum temperature: 100°C

Warnings

- Install controller according to applicable electrical codes. Unit must be installed using Madison R2 Controller. Do not connect directly to line voltage.
- Not for use in hazardous (explosive) environments.
- Do not exceed pressure and temperature ratings.

Options

- Snap in flange / Bulkhead kit for mounting in thin wall tanks. Part number: 009-M03824-Kit.
- Extension kit for increasing length of probes. Part number: 005-M03797-Ext.

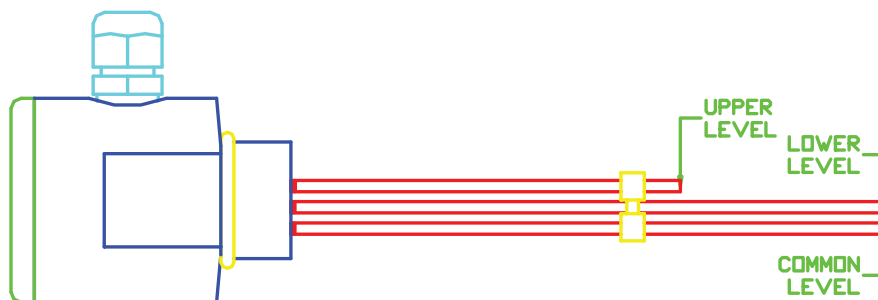


FIGURE 1

Madison Company, Inc.
27 Business Park Drive
Branford, CT 06405

203-488-4477 or 800-466-5383
info@madisonco.com
www.madisonco.com



© 2018 Madison Company, Inc., MAD_MAN_MF-003_060518

ECN #11537, Effective Date 12/6/2019, MF-003-1, Rev D